
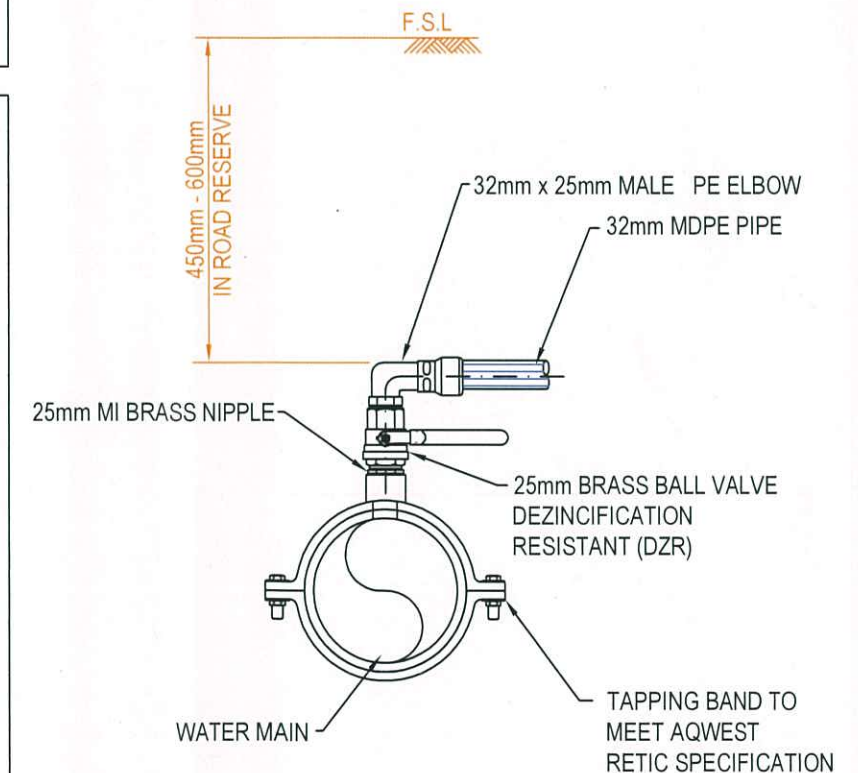
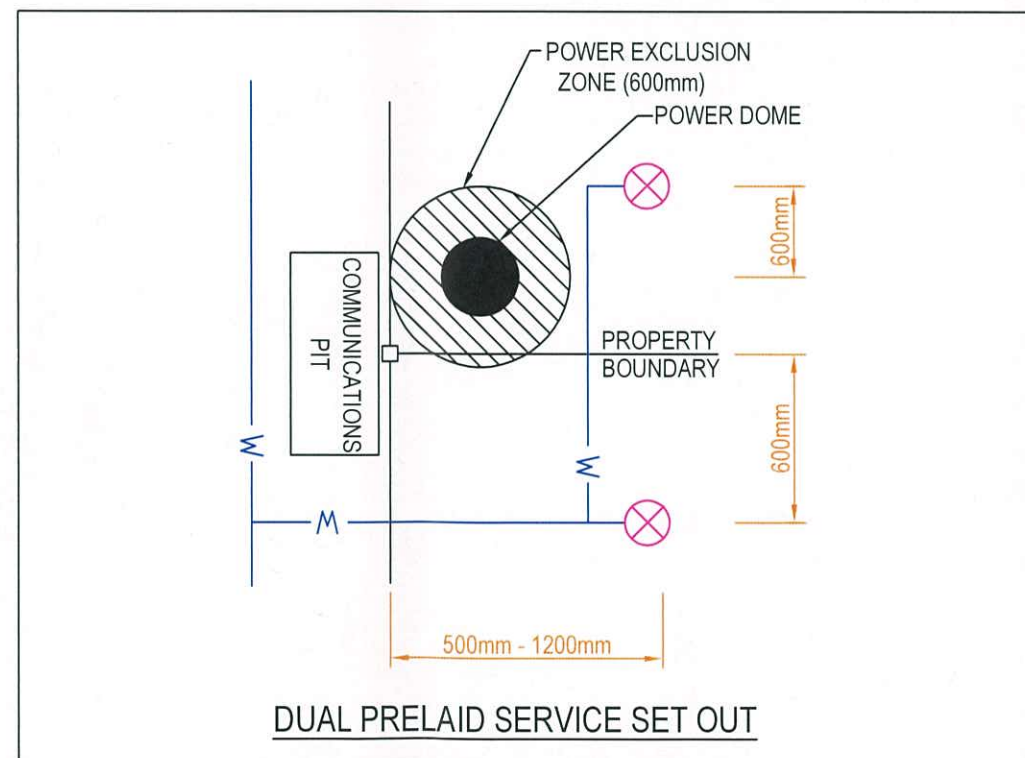
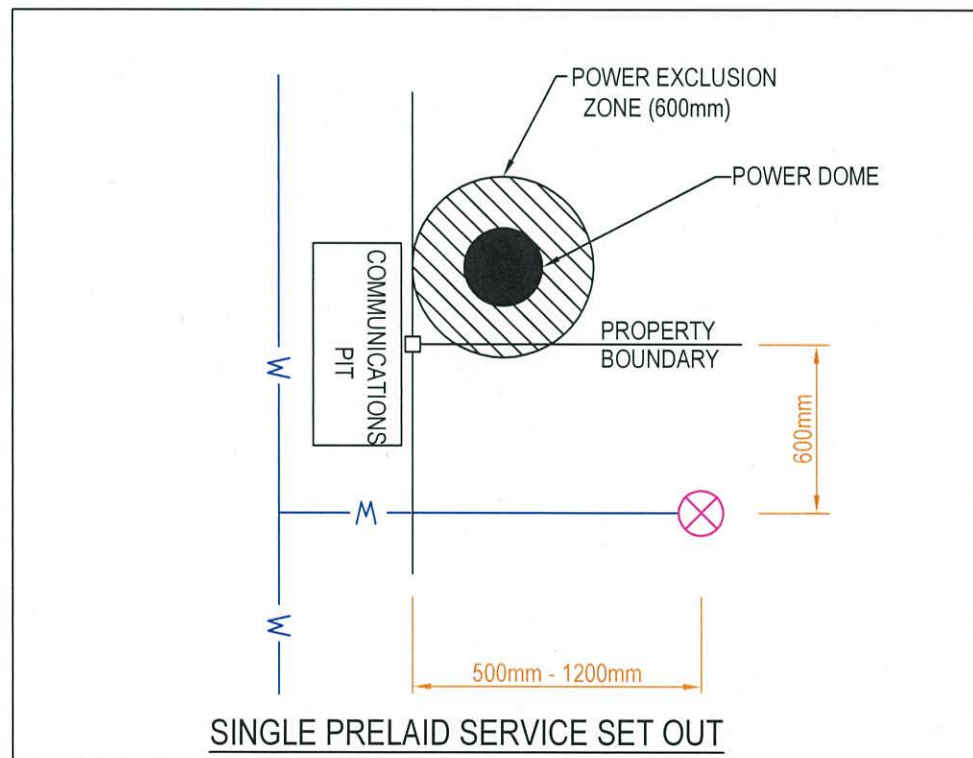
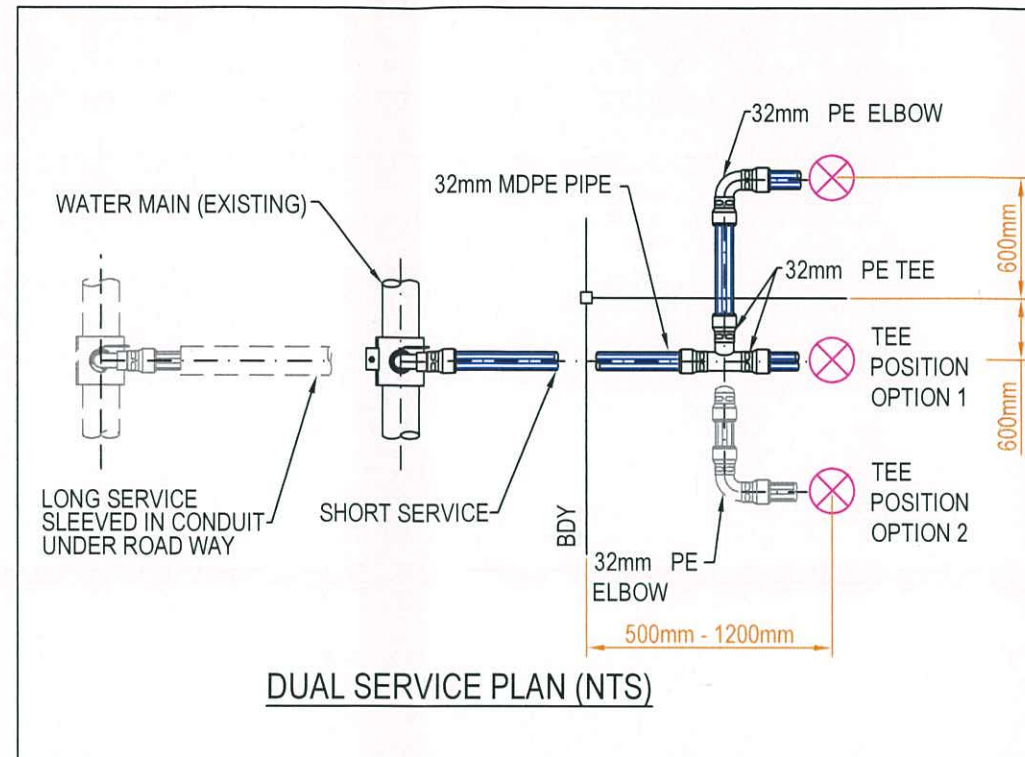
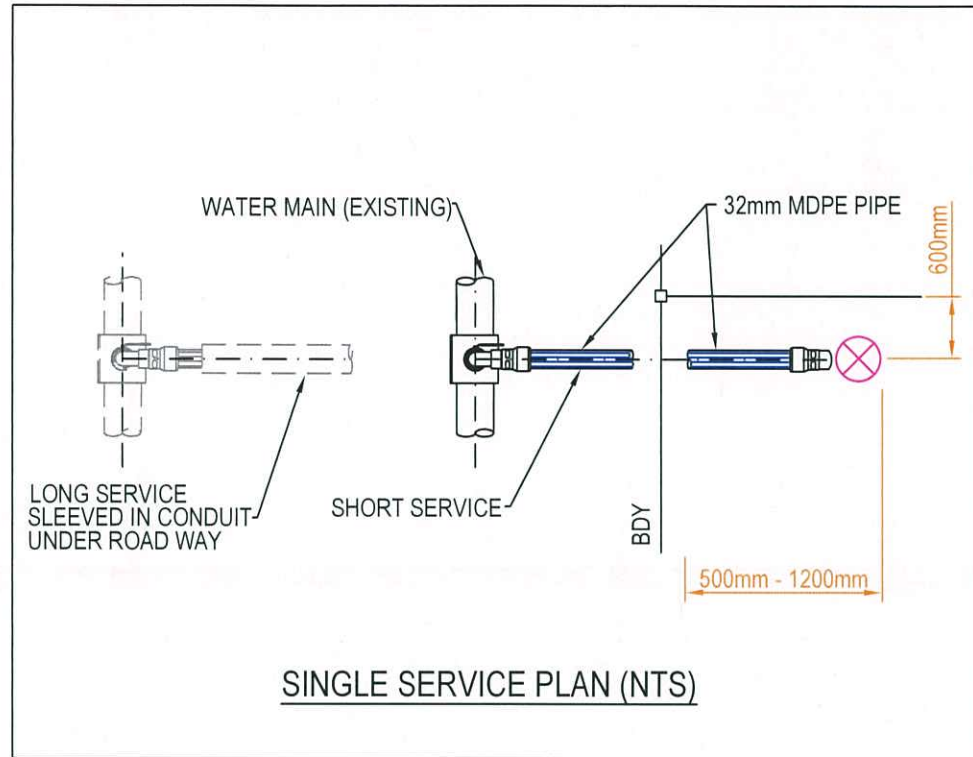


CONSTRUCTION NOTES

1. ALL RETAINING WALLS TO BE PROVIDED WITH A CONDUIT SLEEVE FOR PIPE WORK.
2. MANIFOLD SERVICE DETAILS TO BE APPROVED BY AQWEST.
3.  SERVICE METER CONNECTION



N.T.S



REV	DATE	BY	PM	APP	DESCRIPTION
D	14/01/2016	KJT	TW	GH	ISSUED FOR APPROVAL

FILE NAME: STANDARD DRAWINGS.DWG	
REVISION: D	DATE: 14/01/2016
SCALE: NTS	PAGE SIZE: A3

AQWEST STANDARD DRAWINGS


SERVICE CONNECTION DETAIL - AQS-02

PROJECT MNGR: TW	APPROVED BY: GH	DRAFTED BY: KJT	SHEET NUMBER: 2/5
---------------------	--------------------	--------------------	-----------------------------

CONSTRUCTION NOTES

1. CONDUIT TO BE INSTALLED UNDER ROAD PAVEMENT ON ALL LONG WATER SERVICES.
2. ANY WORK BEYOND THE LIMIT OF AQWEST RESPONSIBILITY TO BE CARRIED OUT BY LICENSED PLUMBER TO AS3500.
3. PROPERTY OWNER SHALL ENSURE ACCESS OF NO LESS THAN 1200mm VERTICALLY AND 300mm HORIZONTALLY AROUND THE WATER METER AT ALL TIMES.
4. AQWEST RESERVE THE RIGHT TO ADJUST ANY STANDARD DESIGN WHERE INSTALLATIONS REQUIRE ALTERATIONS BASED UPON SITE REQUIREMENTS.
5. ANY DIMENSIONS EXCEEDING THE MEASUREMENT SHOWN WILL BE SUBJECT TO WRITTEN APPROVAL BY AQWEST.
6. THE FOLLOWING CONDUIT SIZES SHALL BE USED WHEN PRELAYING LONG SERVICES:

- RESIDENTIAL SINGLE SERVICE - DN50 CLASS 9 PVC
- RESIDENTIAL DUAL SERVICE - DN50 CLASS 9 PVC
- RESIDENTIAL MULTIPLE UNIT SITE - DN80 CLASS 9 PVC
- NON RESIDENTIAL - DN200 CLASS 9 PVC

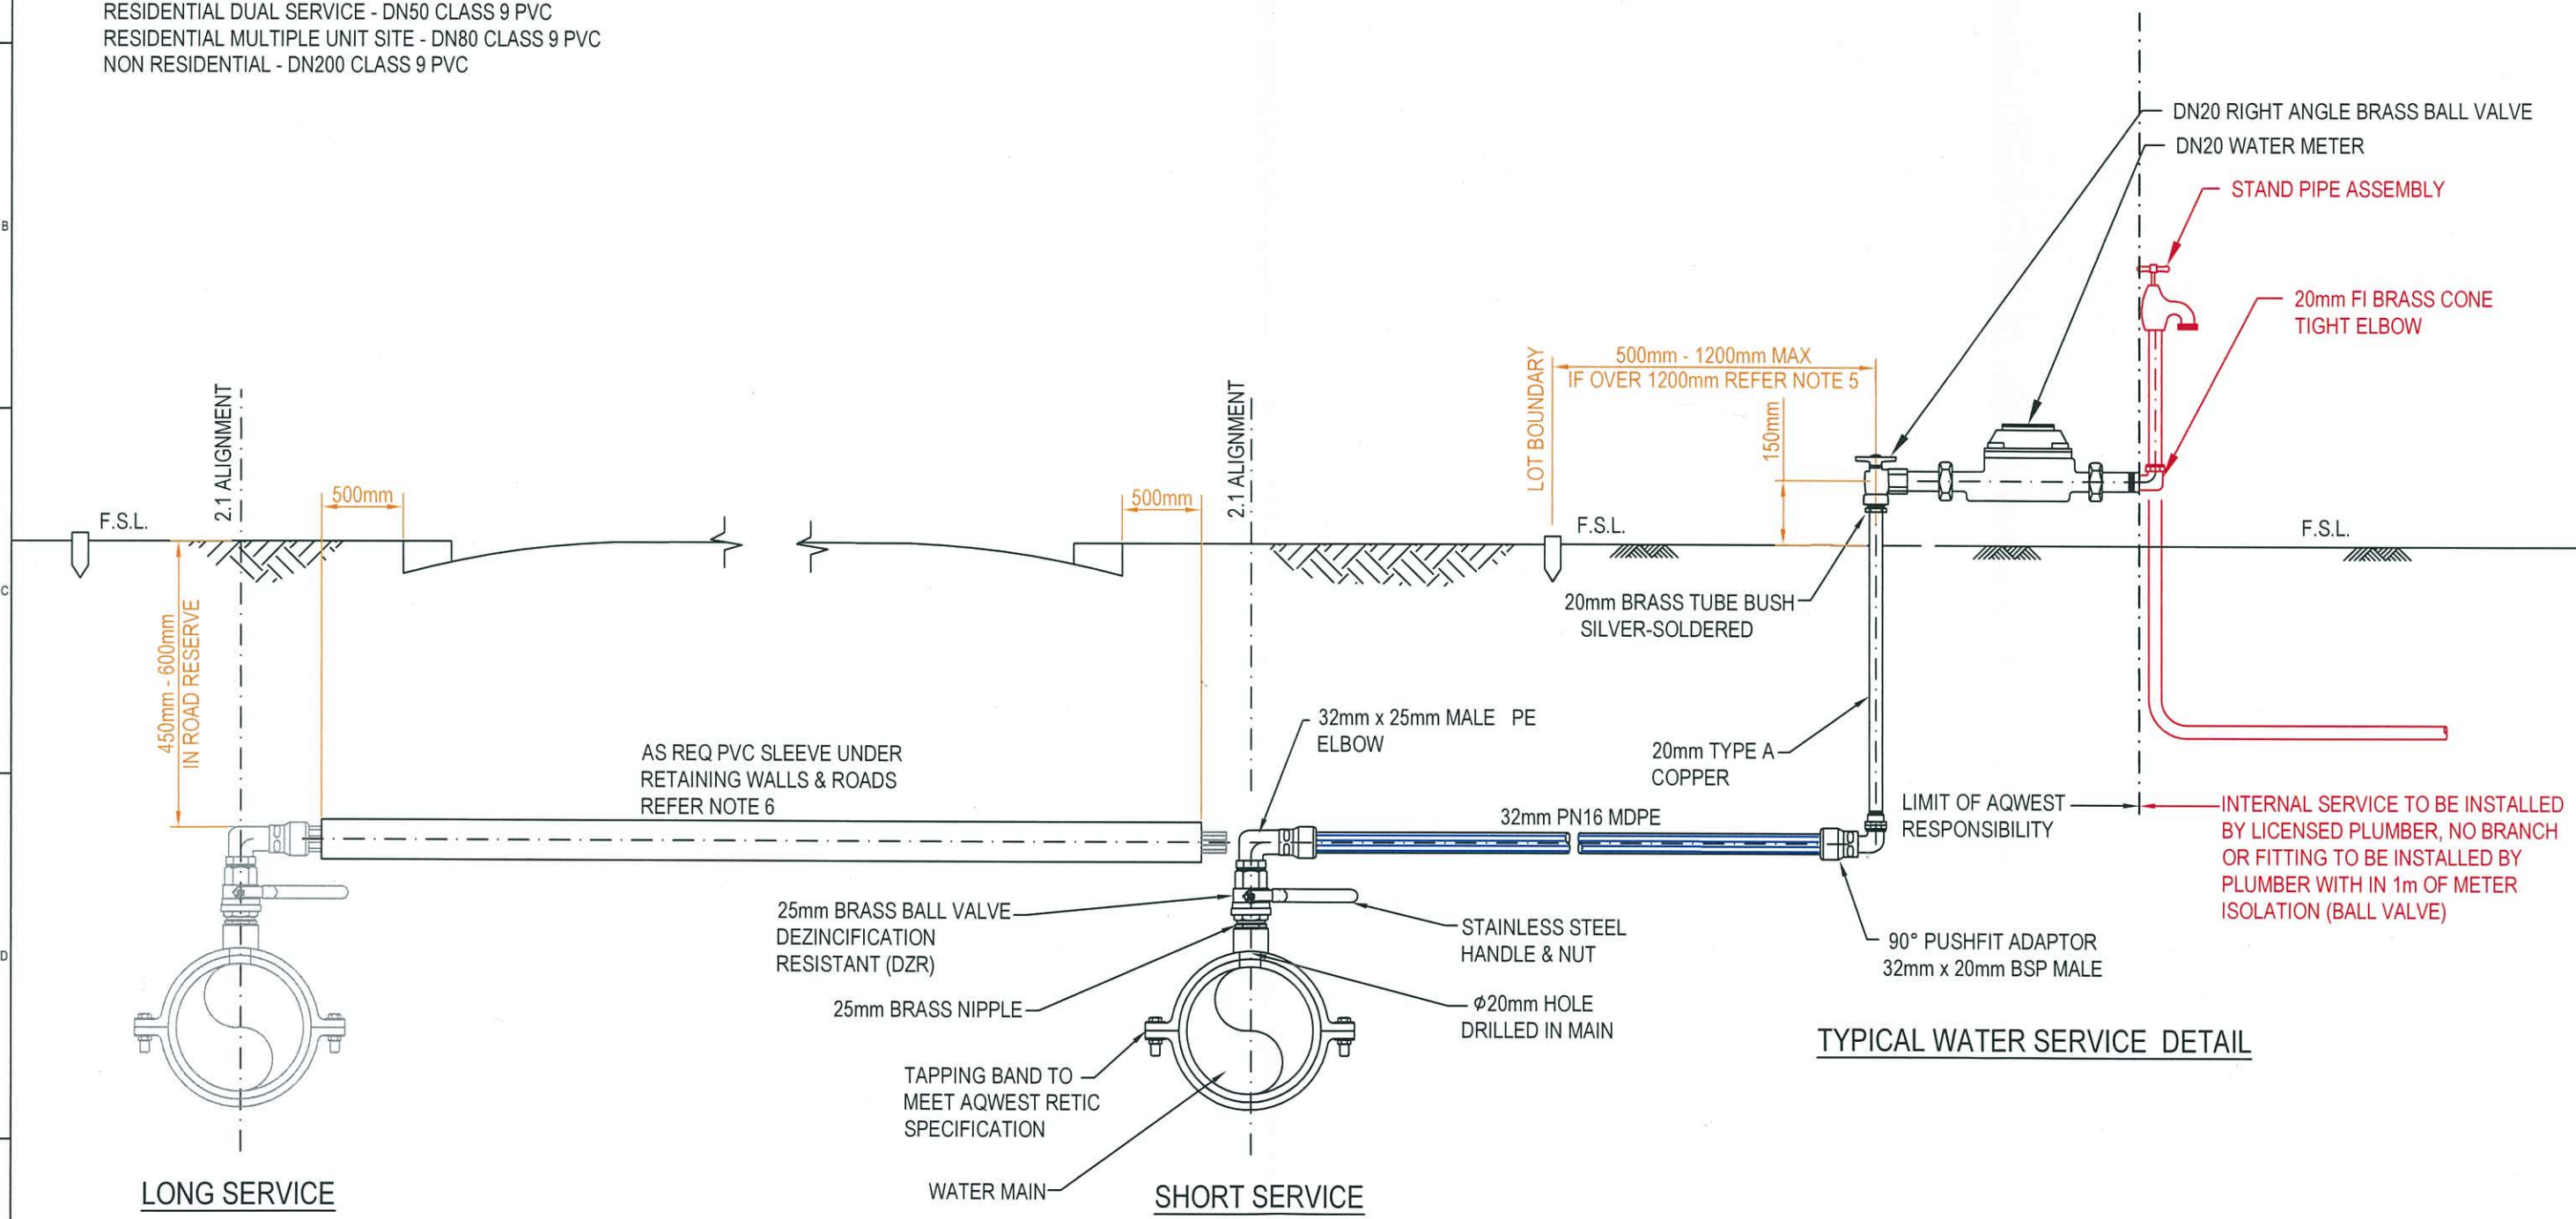

TYPICAL WATER SERVICE DETAIL



REV	DATE	BY	PM	APP	DESCRIPTION
D	14/01/2016	KJT	TW	GH	ISSUED FOR APPROVAL

FILE NAME: STANDARD DRAWINGS.DWG		AQWEST STANDARD DRAWINGS			
REVISION: D	DATE: 14/01/2016	SERVICE INSTALLATION DETAIL - AQS-03			
SCALE: NTS	PAGE SIZE: A3	PROJECT MNGR: TW	APPROVED BY: GH	DRAFTED BY: KJT	SHEET NUMBER: 3/5